

## Surge Suppression Filters

# FTSF2 Series

### Introduction

- Rated current: 0.5A~1600A
- Optional medical versions (H Type)
- Various terminals: wire, solder lug, stud, terminal blocks, etc
- Custom specific versions available on request



### Features and Benefits

- Have both surge and filtering function.
- Surge class conforms to GB/T 17626.5-2008 / IEC61000-4-5:2005 Standard.
- FTSF2 series filter is high performance AC filter, which is designed with two-stage common mode filter circuit. They have excellent common and differential mode filtering effect with filtering range from 10kHz to 30MHz.


### Typical Applications

- Electrical & electronic equipment
- Consumer goods
- Household appliance
- Datacom equipment
- Electronic devices with simultaneous surge and filtering requirements
- Office automation equipment

## Technical Data

Rated Voltage: VR	110/250VAC
Operating Frequency: FR	50/60Hz
Rated Current: IR	0.5~1600A@40 °C
Test Voltage: Vtest	300VDC, 3S(line-line); 2000VAC, 3S(line-ground)
Climatic Category (IEC 60068-1)	25/085/21(-25 °C/+85 °C Damp heat test for 21 days)

## Tabulates

Part No.	Rated Current [A]	Leakage Current [mA] 250VAC/50Hz @20 °C	Terminals		Weight [g]
			 -L	 -W	
FTSF2-3	3	< 0.6	---	○	95
FTSF2-6	6	< 1.0	○	---	170
FTSF2-10	10	< 1.0	○	---	170
FTSF2-20	20	< 1.0	○	---	320


## Surge Test Results



Input voltage waveform (differential mode 2KV)



Output voltage waveform (differential mode 1.3KV)

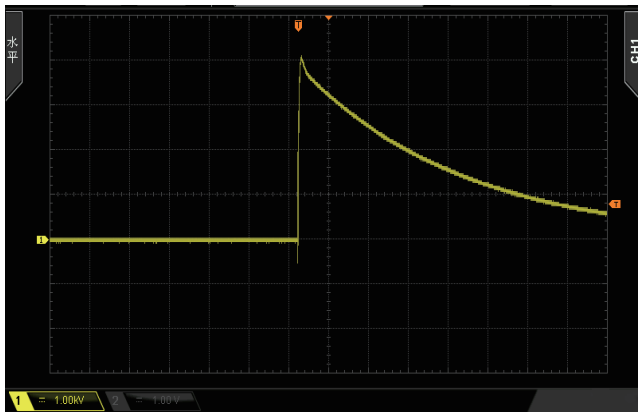

Input voltage waveform (common mode 4KV)




Output voltage waveform (common mode 1.3KV)


## Insertion Loss (dB)

Common Mode


Differential Mode

Note: Insertion loss is tested with a system of empty load and 50  $\Omega$ -50 $\Omega$  according to UL1283 Standard. The actual effect please follow the field data of real application.

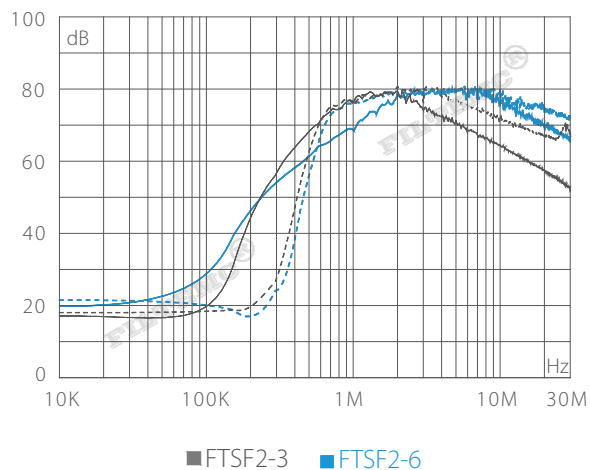


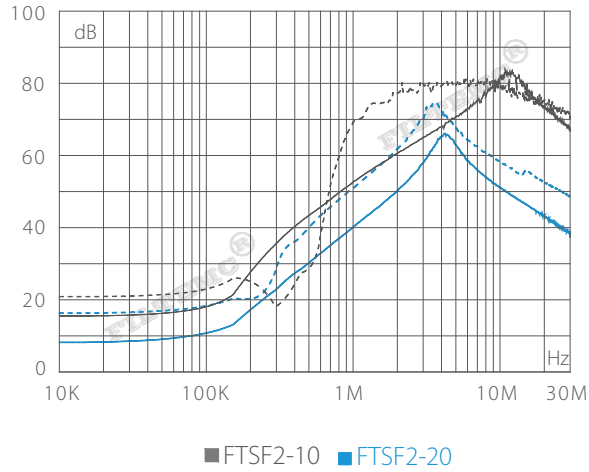


## Outline Drawing and Dimensions (mm)

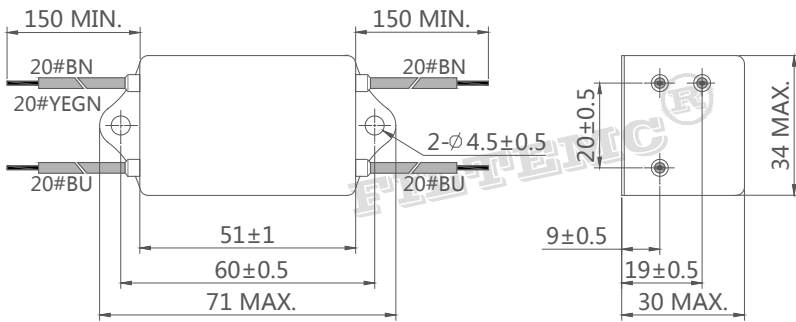

FTSF2-3

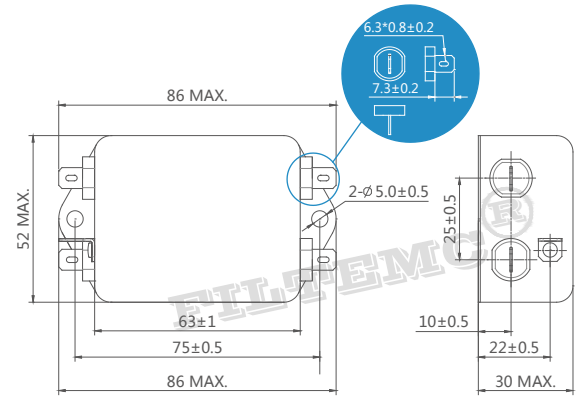

FTSF2-6/10

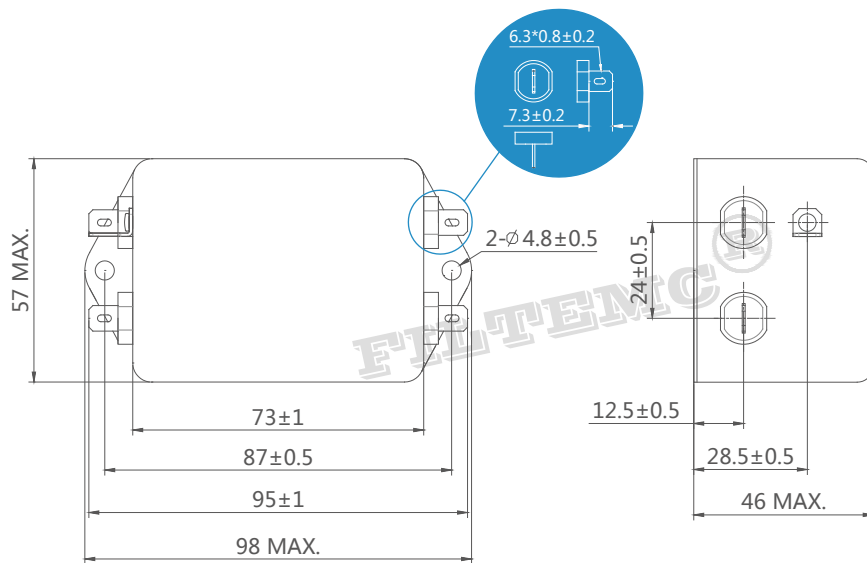

FTSF2-20


## Important Notes on EMI Filter Application

### 1. Storage of EMI Filters:


EMI filters mustn't be left out in the heat of the sun or exposed to the rain, it should be stored in warehouse with good ventilation, surrounding temperature between  $-30^{\circ}\text{C}$  and  $+65^{\circ}\text{C}$ , the highest relative air humidity lower than 90%, and no corrosive liquid or gas.

### 2. Installation of EMI Filters:


- EMI filters should be installed at power input, and the line inside the chassis be as short as possible to reduce radiated interference.
- Both input and output lines of EMI filters neither be intersected nor be tied up by string.
- Make sure the mounting flange fully grounded, and keep the ground cable as short as possible if filters are connected to other equipment.
- If the terminal is stud, please use two spanners to fasten the screw nut when connecting to avoid stud rotating and thus causing changes to the internal circuit and consequently leading to filters arcing, short circuit, broken down or the filtering effect worsened. First use spanner1 to fix the screw nut near the metal case, then use spanner2 to tighten the screw nut in front( shown as Figure1), otherwise the terminals may be damaged. Apply the same for the connection of other phases.
- Keep the tools fastening the stud be vertical to the metal case of filter when installing terminal block filters ( shown as Figure2 ), must not tilt( shown as Figure3 ), otherwise the terminal blocks may be damaged.

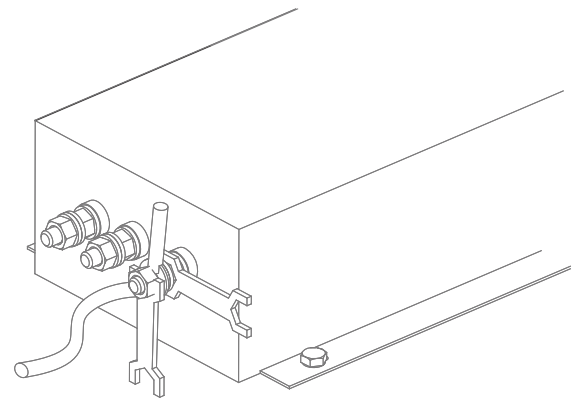

(Figure1)

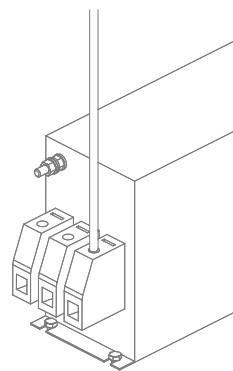

(Figure2)

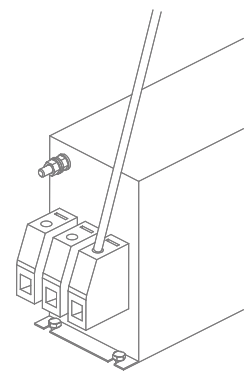

(Figure3)

### 3. Reminding and Warning :

Please read all the safety warnings and instructions before installing filters and putting them into use:

- Don't take terminals as supporting point when moving filters to avoid the terminals distortion, loosening or broken.
- The protective earth connections shall be the first to be made when the EMC filter is installed and the last to be disconnected.
- Filters generate leakage current, please make sure they are well grounded before putting into operation.
- If the rated current is higher than 50A, we recommend grounding by the earth terminals but not only through the metal case of filters.
- Danger of electric shock: EMC filters contain components that store an electric charge. Dangerous voltages can continue to exist at the filter terminals for longer than five minutes even after the power has been switched off.
- The working conditions of EMI filter should comply with the technical parameters stated on the label, over voltage or overload could cause damage to filters. It is suggested to take proper over current protection measures.
- Current drop occurs when the surrounding temperature rises, fail to follow the current drop requirement may lead to impermissible exceeding of the component temperature, as a result the service life of filters will be shortened after long time running.

## Service and Support

#### Contact information of Tech. Dept.:

T: 0086-531-58622887

F: 0086-531-58622899

E: [filtemc@filtemc.com](mailto:filtemc@filtemc.com)

A: Building 20, Xinmao Qilu Science and Technology City, No. 1 Zidong Road, Tianqiao District, Jinan 250119, China

#### Contact information of Sales:

T: 0086-531-58622888

F: 0086-531-58622886

E: [filter@filtemc.com](mailto:filter@filtemc.com)

Skype: Lisawong2016@hotmail.com

Web.: [www.filtemc.com](http://www.filtemc.com)

